


ROOF LEVEL ABOVE FUEL TREATMENT ROOM

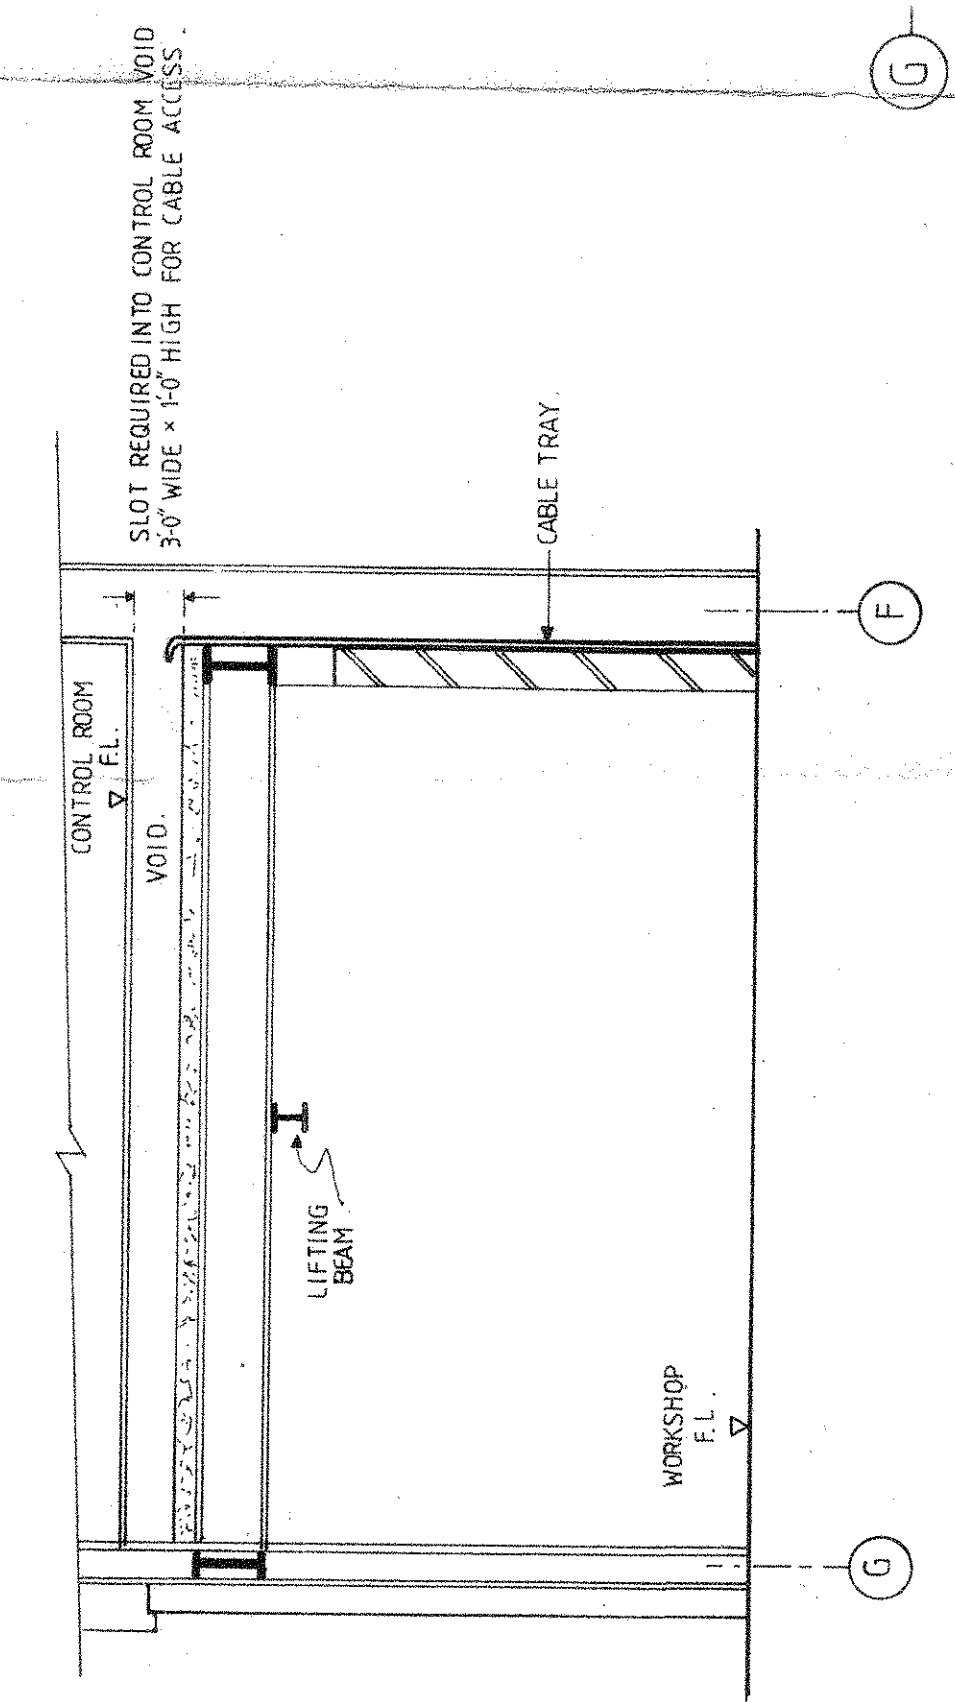

SECTION 'S-S'

NB. CABLE SUPPORT BRACKETS TO BE POSITIONED AT 4'-0\"/>

17 NOV 1981

MAIN CONTRACTOR APE-CROSSLY LTD	PROJECT MAJURO POWER STATION
PRIME CONTRACTOR P/SECO INTERNATIONAL POWER SYSTEMS LTD 85-87 JERMIN STREET LONDON SW1Y 6JD	CLIENT THE GOVERNMENT OF THE MARSHALL ISLANDS
SCALE 1/4" = 1'-0"	DRAWN R/V/G
CHECKED	APPROVED
TITLE ENGINE HALL FIRST FLOOR / ROOF LEVEL CABLE TRAY ROUTING	WH SMITH & CO. ELECTRICAL ENGINEERS LTD.
REVISION	DRAWING No. WHS/13453
DATE	SHT 2 OF 2
CHECKED	